



# 非常用照明器具特性

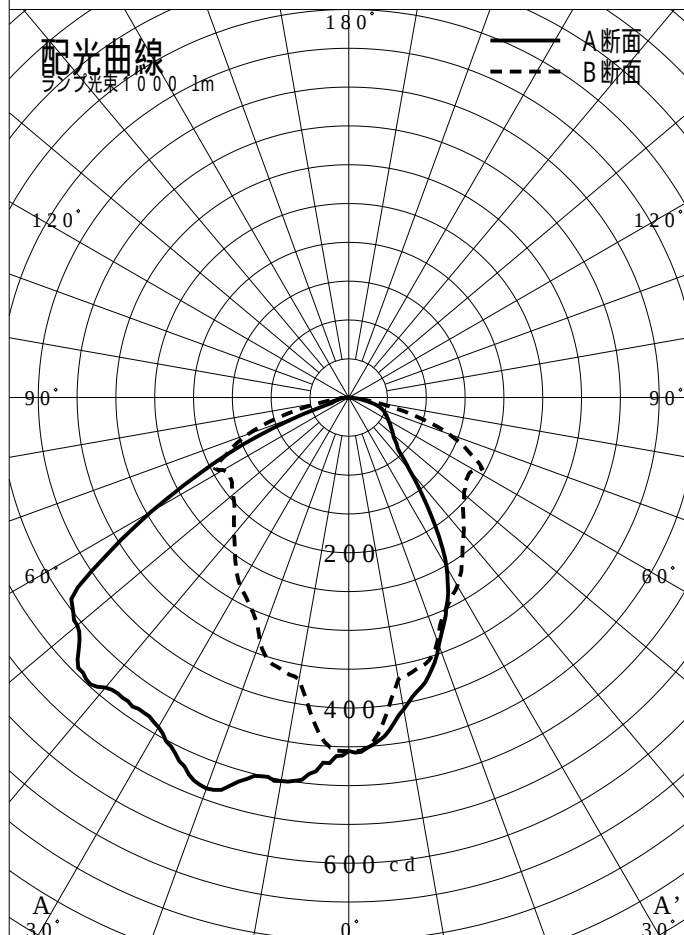


|            |                   |         |         |
|------------|-------------------|---------|---------|
| 品番         | NNCF40135J        |         |         |
| 名称         |                   |         |         |
| 光源         | LED5000/97/535    |         |         |
| 管理番号       | K0169473(1)DR1    |         |         |
| 光束         | 535lm x 1.00      |         |         |
| 保守率        | 0.92              |         |         |
| 適用品番       | 設計照度Eを得るための読取照度   |         |         |
|            | E = 2.0           | E = 1.0 | E = 0.5 |
| NNCF40135J | 4.1               | 2.0     | 1.0     |
|            |                   |         |         |
|            |                   |         |         |
|            |                   |         |         |
| 備考         | 非常点灯時の照度 ( 30 分後) |         |         |

## 直射水平面照度

100 lx ( x 10 )  
ランプ光束1000lm

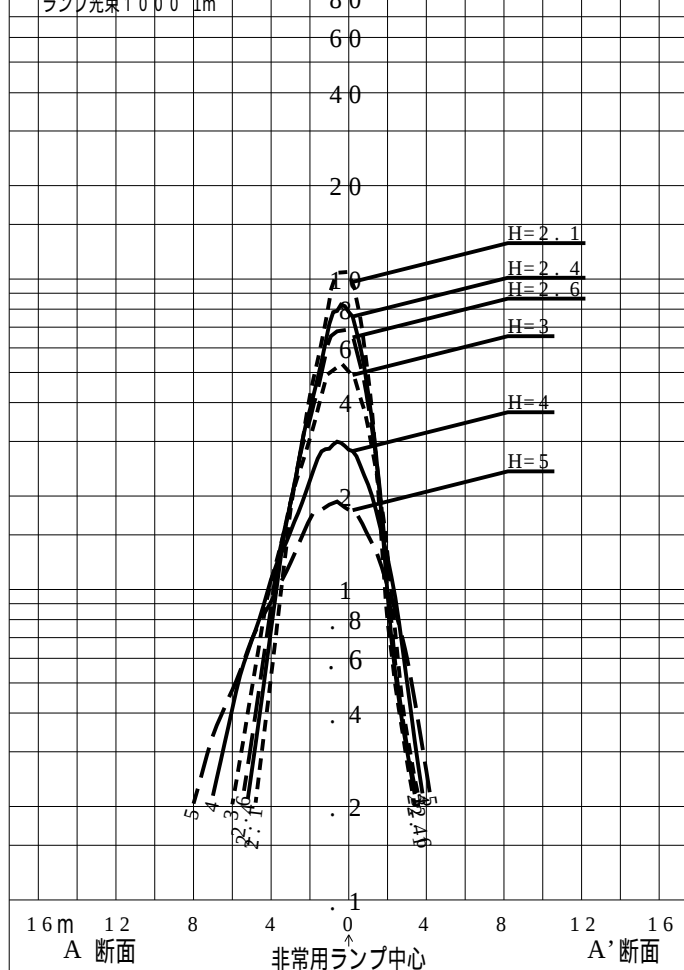

100 lx ( x 10 )

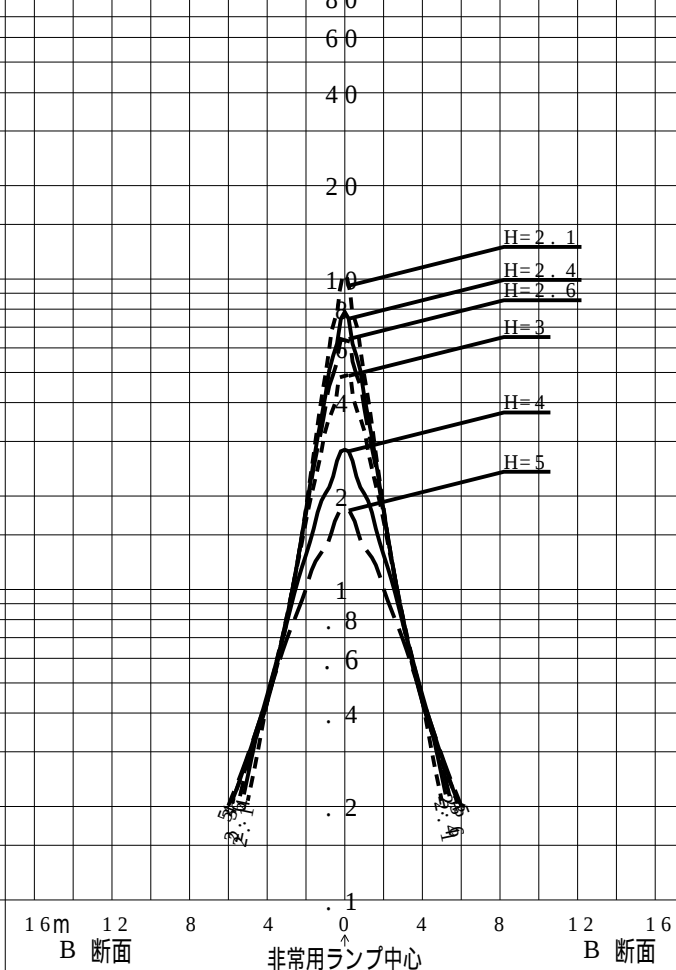

|      |                  |  |  |    |                 |
|------|------------------|--|--|----|-----------------|
| 品番   | NNCF40135J       |  |  |    |                 |
| 名称   |                  |  |  |    |                 |
| 光源   | LED5000/97/535   |  |  |    |                 |
| 管理番号 | K0169473( 1)DR 1 |  |  |    |                 |
| 光束   | 535.0 l m * 1.00 |  |  | 備考 | 非常点灯時の照度 (30分後) |
| 保守率  | 0.92             |  |  |    |                 |

非常灯配置表

|             |      |     |     |     |     |     |     |      |      |      |      |      |      |      |      |      |      |
|-------------|------|-----|-----|-----|-----|-----|-----|------|------|------|------|------|------|------|------|------|------|
| 器具取付高さ (m)  |      | 2.1 | 2.2 | 2.3 | 2.4 | 2.5 | 2.6 | 2.7  | 2.8  | 2.9  | 3.0  | 3.1  | 3.2  | 3.3  | 3.4  | 3.5  | 3.6  |
| 単体配置        | A1   | 4.2 | 4.3 | 4.5 | 4.6 | 4.7 | 4.8 | 4.9  | 5.0  | 5.1  | 5.2  | 5.3  | 5.4  | 5.5  | 5.6  | 5.6  | 5.7  |
|             | A' 1 | 2.6 | 2.6 | 2.7 | 2.7 | 2.7 | 2.7 | 2.8  | 2.8  | 2.8  | 2.8  | 2.9  | 2.9  | 3.0  | 3.0  | 3.0  | 3.1  |
|             | B1   | 4.1 | 4.2 | 4.2 | 4.2 | 4.2 | 4.2 | 4.2  | 4.2  | 4.2  | 4.2  | 4.2  | 4.2  | 4.2  | 4.2  | 4.2  | 4.3  |
|             |      |     |     |     |     |     |     |      |      |      |      |      |      |      |      |      |      |
| 直線配置        | A2   | 7.8 | 8.0 | 8.2 | 8.3 | 8.5 | 8.6 | 8.7  | 9.0  | 9.1  | 9.2  | 9.3  | 9.6  | 9.6  | 9.7  | 9.9  | 10.2 |
|             | B2   | 8.9 | 9.1 | 9.3 | 9.5 | 9.7 | 9.9 | 10.1 | 10.3 | 10.4 | 10.6 | 10.7 | 10.9 | 11.0 | 11.1 | 11.3 | 11.4 |
| 四角配置        | A4   | 5.5 | 5.6 | 5.8 | 6.0 | 6.2 | 6.4 | 6.6  | 6.8  | 7.0  | 7.2  | 7.4  | 7.6  | 7.9  | 8.1  | 8.4  | 8.5  |
|             | B4   | 8.6 | 8.8 | 9.0 | 9.1 | 9.2 | 9.4 | 9.4  | 9.5  | 9.7  | 9.7  | 9.8  | 9.9  | 9.9  | 9.8  | 9.8  | 9.9  |
| 壁からの距離 (最大) | A0   | 1.1 | 1.1 | 1.1 | 1.3 | 1.3 | 1.3 | 1.4  | 1.4  | 1.4  | 1.5  | 1.5  | 1.6  | 1.7  | 1.8  | 2.0  | 2.0  |
|             | B0   | 3.1 | 3.2 | 3.2 | 3.2 | 3.3 | 3.3 | 3.3  | 3.3  | 3.3  | 3.3  | 3.3  | 3.3  | 3.3  | 3.2  | 3.0  | 3.1  |

|             |      |      |      |      |      |      |      |      |      |      |      |      |      |      |      |      |      |
|-------------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| 器具取付高さ (m)  |      | 3.7  | 3.8  | 3.9  | 4.0  | 4.1  | 4.2  | 4.3  | 4.4  | 4.5  | 5.0  | 5.5  | 6.0  | 6.5  | 7.0  | 7.5  | 8.0  |
| 単体配置        | A1   | 5.8  | 5.9  | 6.0  | 6.0  | 6.1  | 6.2  | 6.3  | 6.3  | 6.4  | 6.5  | 6.5  | 6.5  | 6.5  | 6.4  | 6.1  | 5.7  |
|             | A' 1 | 3.1  | 3.1  | 3.2  | 3.2  | 3.2  | 3.3  | 3.3  | 3.3  | 3.4  | 3.5  | 3.6  | 3.7  | 3.7  | 3.6  | 3.4  | 3.2  |
|             | B1   | 4.3  | 4.3  | 4.3  | 4.3  | 4.3  | 4.3  | 4.3  | 4.3  | 4.3  | 4.2  | 4.2  | 4.1  | 3.9  | 3.7  | 3.4  | 3.1  |
|             |      |      |      |      |      |      |      |      |      |      |      |      |      |      |      |      |      |
| 直線配置        | A2   | 10.2 | 10.3 | 10.4 | 10.5 | 10.8 | 10.8 | 10.9 | 11.2 | 11.2 | 12.0 | 12.2 | 12.5 | 12.8 | 13.0 | 13.2 | 13.2 |
|             | B2   | 11.4 | 11.5 | 11.5 | 11.5 | 11.5 | 11.5 | 11.5 | 11.6 | 11.6 | 11.6 | 11.6 | 11.6 | 11.5 | 11.5 | 11.4 | 11.2 |
| 四角配置        | A4   | 8.8  | 9.0  | 9.2  | 9.3  | 9.5  | 9.5  | 9.5  | 9.5  | 9.6  | 10.2 | 11.0 | 11.6 | 11.8 | 12.4 | 12.4 | 11.8 |
|             | B4   | 9.8  | 9.9  | 9.9  | 10.0 | 10.0 | 10.2 | 10.4 | 10.6 | 10.7 | 11.0 | 11.0 | 11.1 | 11.3 | 11.1 | 11.3 | 11.2 |
| 壁からの距離 (最大) | A0   | 2.1  | 2.1  | 2.2  | 2.2  | 2.2  | 2.1  | 2.1  | 2.0  | 1.9  | 1.8  | 1.7  | 1.7  | 1.3  | 1.6  | 1.1  | 1.0  |
|             | B0   | 2.9  | 3.0  | 2.9  | 2.9  | 2.9  | 2.9  | 3.0  | 3.0  | 3.0  | 3.0  | 2.8  | 2.2  | 2.3  | 1.7  | 1.7  | 2.0  |

|             |      |      |      |      |      |      |  |  |  |  |  |  |  |  |  |  |  |
|-------------|------|------|------|------|------|------|--|--|--|--|--|--|--|--|--|--|--|
| 器具取付高さ (m)  |      | 8.5  | 9.0  | 9.5  | 10.0 | 10.5 |  |  |  |  |  |  |  |  |  |  |  |
| 単体配置        | A1   | 5.4  | 5.0  | 4.7  | 4.3  | ---- |  |  |  |  |  |  |  |  |  |  |  |
|             | A' 1 | 2.9  | 2.6  | 2.1  | 1.5  | ---- |  |  |  |  |  |  |  |  |  |  |  |
|             | B1   | 2.9  | 2.3  | 1.5  | 1.1  | ---- |  |  |  |  |  |  |  |  |  |  |  |
|             |      |      |      |      |      |      |  |  |  |  |  |  |  |  |  |  |  |
| 直線配置        | A2   | 13.1 | 12.9 | 12.8 | 12.6 | 9.5  |  |  |  |  |  |  |  |  |  |  |  |
|             | B2   | 11.0 | 10.8 | 10.4 | 9.9  | 9.2  |  |  |  |  |  |  |  |  |  |  |  |
| 四角配置        | A4   | 12.2 | 12.5 | 12.8 | 12.6 | 9.5  |  |  |  |  |  |  |  |  |  |  |  |
|             | B4   | 11.0 | 10.8 | 10.4 | 9.9  | 9.2  |  |  |  |  |  |  |  |  |  |  |  |
| 壁からの距離 (最大) | A0   | 1.0  | 1.0  | 1.0  | 1.0  | 1.0  |  |  |  |  |  |  |  |  |  |  |  |
|             | B0   | 1.6  | 1.5  | 1.2  | 1.2  | 1.0  |  |  |  |  |  |  |  |  |  |  |  |

階段配置表

|            |        |    |     |     |     |     |     |     |     |     |     |     |
|------------|--------|----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| 器具取付高さ (m) |        |    | 1.0 | 1.5 | 2.0 | 2.5 | 3.0 | 4.0 | 5.0 | 6.0 | 7.0 | 8.0 |
| Y=1.0 ( m) | 2.0 Lx | X+ | 2.3 | 3.1 | 3.8 | 4.3 | 4.8 | 5.7 | 6.0 | 6.1 | 6.0 | 5.4 |
|            |        | X- | 1.8 | 2.1 | 2.3 | 2.5 | 2.7 | 3.1 | 3.3 | 3.3 | 3.1 | 2.6 |
|            | 1.0 Lx | X+ | 2.6 | 3.6 | 4.4 | 5.1 | 5.7 | 6.8 | 7.8 | 8.5 | 8.9 | 9.0 |
| Y=1.5 ( m) | 2.0 Lx | X+ | 2.1 | 2.9 | 3.6 | 4.2 | 4.7 | 5.3 | 5.5 | 5.5 | 5.1 | 4.6 |
|            |        | X- | 1.4 | 1.8 | 2.1 | 2.3 | 2.6 | 3.0 | 3.2 | 3.2 | 2.8 | 2.2 |
|            | 1.0 Lx | X+ | 2.5 | 3.4 | 4.3 | 4.9 | 5.5 | 6.5 | 7.5 | 8.2 | 8.4 | 8.5 |
| Y=2.0 ( m) | 2.0 Lx | X+ | 1.8 | 2.7 | 3.3 | 4.0 | 4.5 | 5.2 | 5.3 | 5.2 | 4.6 | 3.9 |
|            |        | X- | 0.9 | 1.5 | 1.9 | 2.2 | 2.5 | 2.9 | 3.1 | 3.0 | 2.8 | 2.2 |
|            | 1.0 Lx | X+ | 2.2 | 3.2 | 4.0 | 4.7 | 5.4 | 6.5 | 7.3 | 7.7 | 7.8 | 8.0 |