



# 非常用照明器具特性

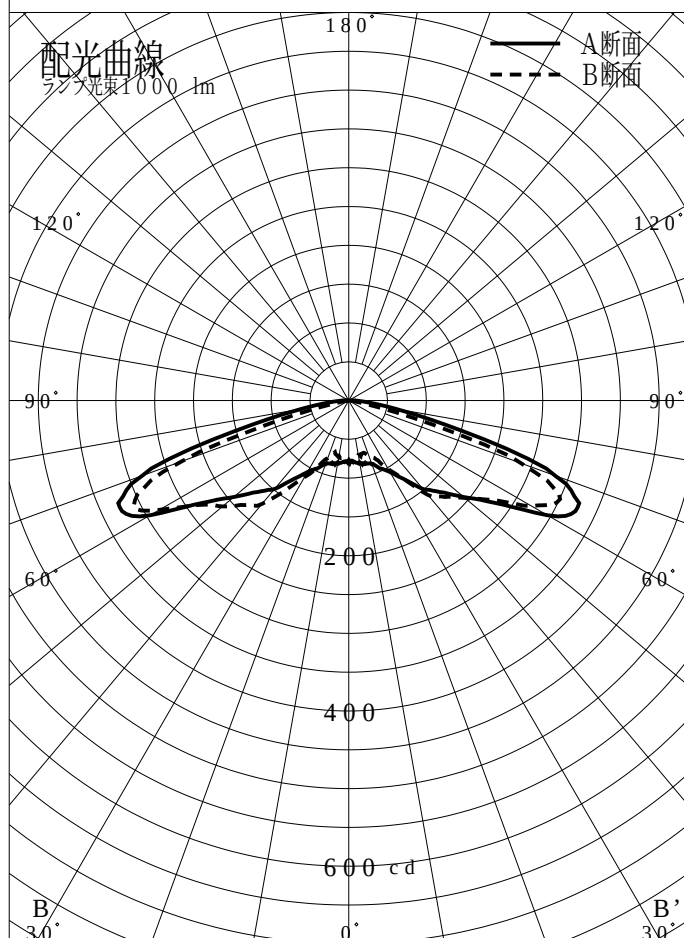

|           |                   |         |         |
|-----------|-------------------|---------|---------|
| 品番        | XDL411NGN         |         |         |
| 名称        |                   |         |         |
| 光源        | LED5000/98/665    |         |         |
| 管理番号      | K0176557(0)DR1    |         |         |
| 光束        | 665lm x 1.00      |         |         |
| 保守率       | 0.93              |         |         |
| 適用品番      | 設計照度Eを得るための読取照度   |         |         |
|           | E = 2.0           | E = 1.0 | E = 0.5 |
| XDL411NGN | 3.2               | 1.6     | 0.8     |
|           |                   |         |         |
|           |                   |         |         |
|           |                   |         |         |
| 備考        | 非常点灯時の照度 ( 30 分後) |         |         |

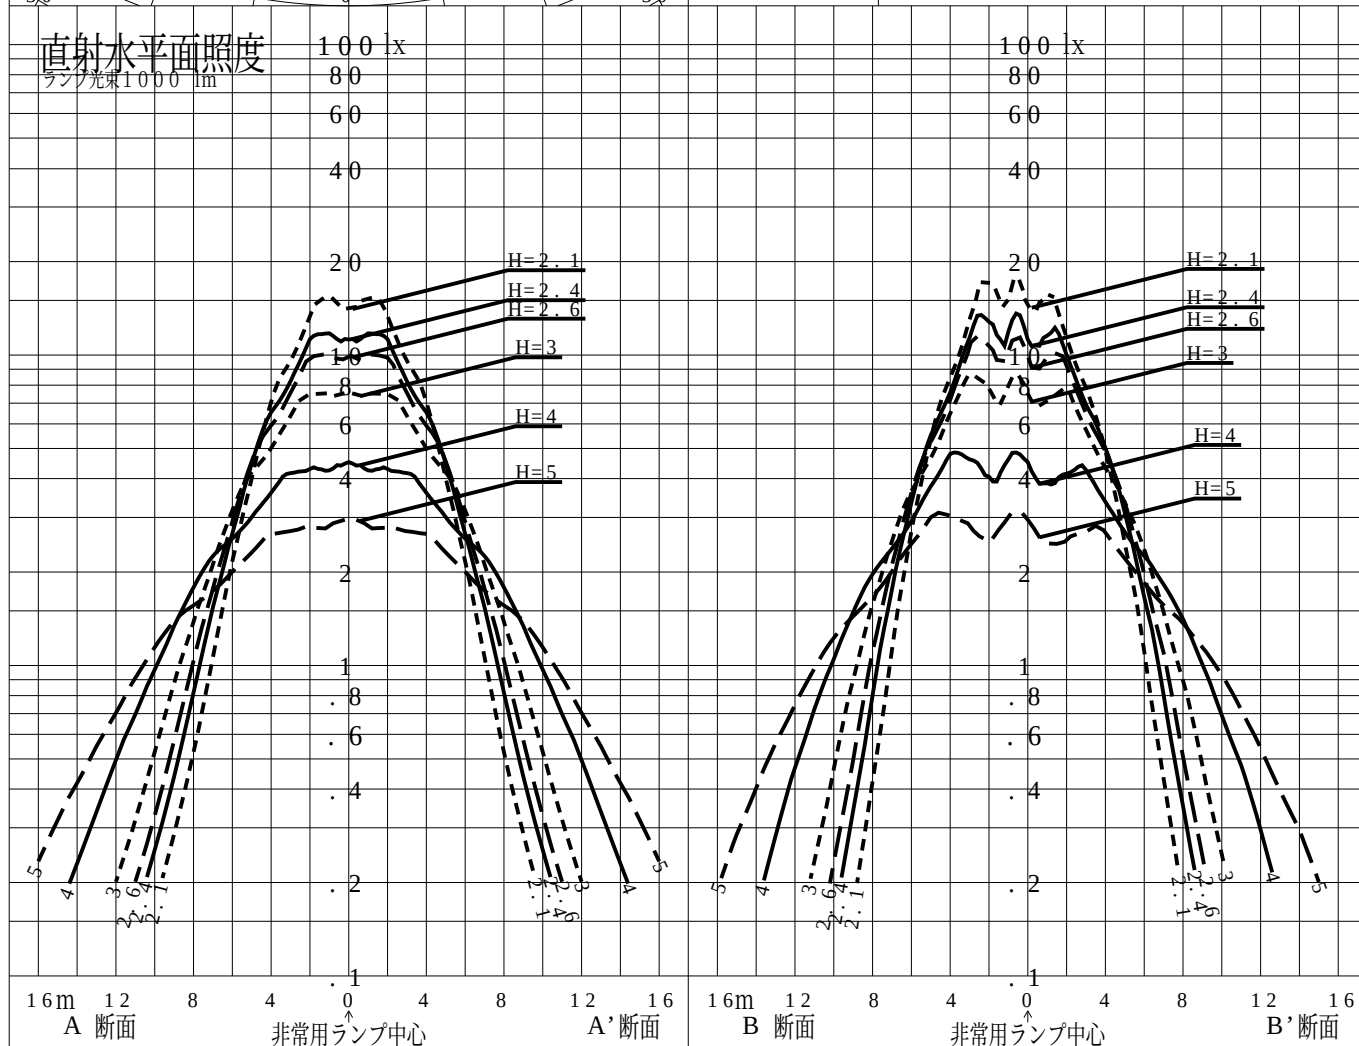

|      |                           |  |    |                   |
|------|---------------------------|--|----|-------------------|
| 品番   | XDL 4 1 1 NGN             |  |    |                   |
| 名称   |                           |  |    |                   |
| 光源   | LED5 0 0 0 / 9 8 / 6 6 5  |  |    |                   |
| 管理番号 | K0 1 7 6 5 5 7 ( 0 ) DR 1 |  |    |                   |
| 光束   | 6 6 5 . 0 1 m * 1 . 0 0   |  | 備考 | 非常点灯時の照度 (3 0 分後) |
| 保守率  | 0 . 9 3                   |  |    |                   |

非常灯配置表

|             |      |      |      |      |      |      |      |      |      |      |      |      |      |      |      |      |      |
|-------------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| 器具取付高さ (m)  |      | 2.1  | 2.2  | 2.3  | 2.4  | 2.5  | 2.6  | 2.7  | 2.8  | 2.9  | 3.0  | 3.1  | 3.2  | 3.3  | 3.4  | 3.5  | 3.6  |
| 単体配置        | A1   | 5.4  | 5.5  | 5.6  | 5.6  | 5.7  | 5.8  | 5.9  | 5.9  | 5.9  | 6.0  | 6.0  | 6.0  | 5.9  | 5.8  | 5.6  | 5.3  |
|             |      |      |      |      |      |      |      |      |      |      |      |      |      |      |      |      |      |
|             | B1   | 5.8  | 5.9  | 6.0  | 6.1  | 6.2  | 6.2  | 6.3  | 6.3  | 6.4  | 6.4  | 6.4  | 6.4  | 6.3  | 6.2  | 6.1  | 5.9  |
|             | B' 1 | 4.7  | 4.8  | 4.9  | 4.9  | 5.0  | 5.1  | 5.1  | 5.2  | 5.2  | 5.2  | 5.1  | 5.1  | 5.0  | 4.9  | 4.7  | 4.6  |
| 直線配置        | A2   | 12.5 | 12.8 | 13.2 | 13.5 | 13.7 | 14.0 | 14.3 | 14.5 | 14.7 | 15.0 | 15.1 | 15.3 | 15.5 | 15.7 | 15.9 | 16.0 |
|             | B2   | 12.1 | 12.5 | 12.8 | 13.1 | 13.4 | 13.7 | 13.9 | 14.2 | 14.5 | 14.7 | 14.9 | 15.1 | 15.3 | 15.5 | 15.6 | 15.8 |
| 四角配置        | A4   | 11.2 | 11.4 | 11.7 | 11.8 | 12.1 | 12.3 | 12.5 | 12.6 | 13.0 | 13.1 | 13.4 | 13.4 | 13.5 | 13.7 | 13.9 | 14.1 |
|             | B4   | 10.6 | 10.9 | 11.1 | 11.5 | 11.7 | 12.0 | 12.2 | 12.5 | 12.6 | 12.9 | 13.0 | 13.4 | 13.6 | 13.8 | 13.9 | 14.1 |
| 壁からの距離 (最大) | A0   | 3.5  | 3.6  | 3.7  | 3.6  | 3.8  | 3.6  | 3.7  | 3.7  | 3.8  | 3.7  | 3.8  | 3.7  | 3.6  | 3.6  | 3.6  | 3.6  |
|             | B0   | 2.6  | 2.7  | 2.8  | 2.9  | 2.9  | 3.0  | 3.0  | 3.1  | 3.1  | 3.2  | 3.1  | 3.2  | 3.3  | 3.3  | 3.2  | 3.2  |

|             |      |      |      |      |      |      |      |      |      |      |  |  |  |  |  |  |  |
|-------------|------|------|------|------|------|------|------|------|------|------|--|--|--|--|--|--|--|
| 器具取付高さ (m)  |      | 3.7  | 3.8  | 3.9  | 4.0  | 4.1  | 4.2  | 4.3  | 4.4  | 4.5  |  |  |  |  |  |  |  |
| 単体配置        | A1   | 5.1  | 4.9  | 4.8  | 4.7  | 4.5  | 4.3  | 4.2  | ---- | ---- |  |  |  |  |  |  |  |
|             |      |      |      |      |      |      |      |      |      |      |  |  |  |  |  |  |  |
|             | B1   | 5.8  | 5.8  | 5.7  | 5.6  | 5.6  | 5.5  | 5.4  | ---- | ---- |  |  |  |  |  |  |  |
|             | B' 1 | 4.5  | 4.4  | 4.3  | 4.2  | 4.1  | 4.0  | 3.9  | ---- | ---- |  |  |  |  |  |  |  |
| 直線配置        | A2   | 16.2 | 16.3 | 16.4 | 16.5 | 16.6 | 16.5 | 16.4 | 16.3 | 15.9 |  |  |  |  |  |  |  |
|             | B2   | 15.9 | 16.0 | 16.0 | 16.1 | 16.1 | 16.1 | 16.1 | 16.1 | 15.8 |  |  |  |  |  |  |  |
| 四角配置        | A4   | 14.2 | 14.4 | 14.6 | 14.6 | 14.9 | 15.0 | 15.2 | 15.4 | 15.4 |  |  |  |  |  |  |  |
|             | B4   | 14.3 | 14.4 | 14.5 | 14.8 | 14.8 | 15.0 | 15.1 | 15.2 | 15.4 |  |  |  |  |  |  |  |
| 壁からの距離 (最大) | A0   | 3.4  | 3.4  | 3.4  | 3.2  | 3.2  | 3.1  | 3.0  | 1.0  | 1.0  |  |  |  |  |  |  |  |
|             | B0   | 3.3  | 3.2  | 3.2  | 3.3  | 3.1  | 3.1  | 3.1  | 1.0  | 1.0  |  |  |  |  |  |  |  |

|             |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |
|-------------|--|--|--|--|--|--|--|--|--|--|--|--|--|--|--|--|--|
| 器具取付高さ (m)  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |
| 単体配置        |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |
|             |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |
|             |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |
|             |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |
| 直線配置        |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |
|             |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |
| 四角配置        |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |
|             |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |
| 壁からの距離 (最大) |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |
|             |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |