



# 非常用照明器具特性

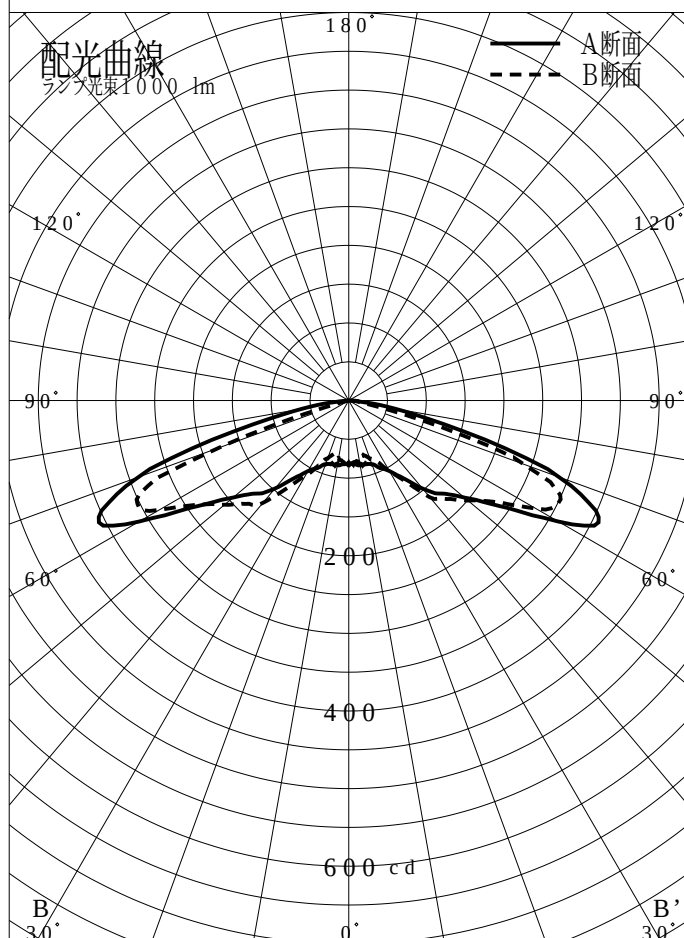

|               |                          |         |         |
|---------------|--------------------------|---------|---------|
| 品番            | XDL 2 1 3 RGN            |         |         |
| 名称            |                          |         |         |
| 光源            | LED5 000 / 98 / 665      |         |         |
| 管理番号          | K0 1 7 3 5 2 2 ( 0 ) DR1 |         |         |
| 光束            | 665lm x 1.00             |         |         |
| 保守率           | 0.88                     |         |         |
| 適用品番          | 設計照度Eを得るための読取照度          |         |         |
|               | E = 2.0                  | E = 1.0 | E = 0.5 |
| XDL 2 1 3 RGN | 3.4                      | 1.7     | 0.9     |
|               |                          |         |         |
|               |                          |         |         |
|               |                          |         |         |
| 備考            | 非常点灯時の照度 ( 30 分後)        |         |         |

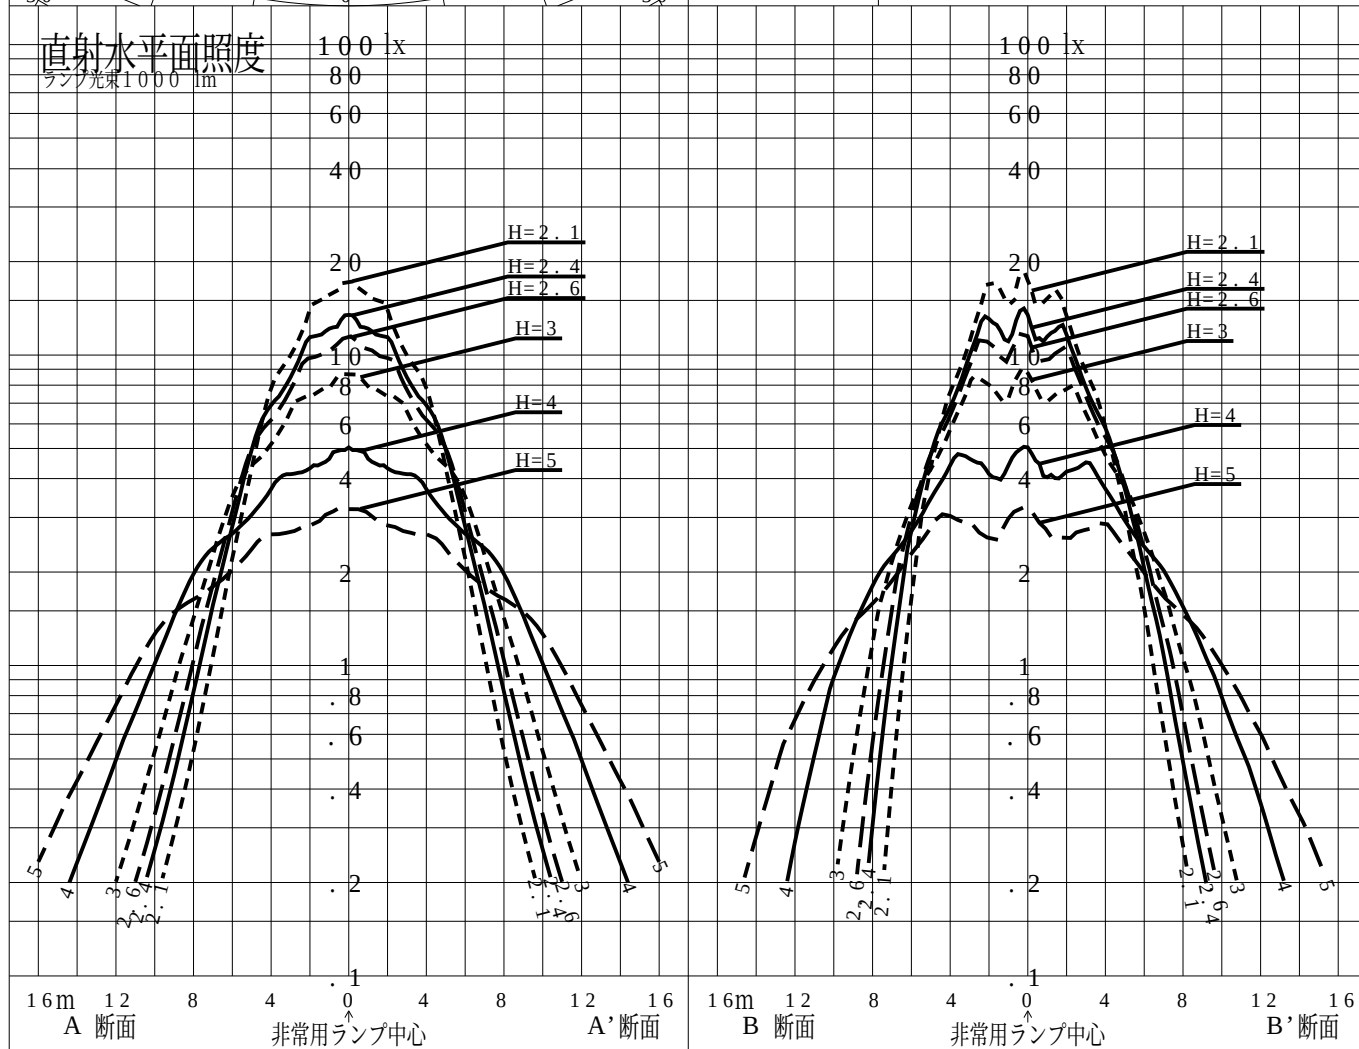

|      |                     |  |  |    |                 |
|------|---------------------|--|--|----|-----------------|
| 品番   | XDL 2 1 3 RGN       |  |  |    |                 |
| 名称   |                     |  |  |    |                 |
| 光源   | LED5000 / 98 / 665  |  |  |    |                 |
| 管理番号 | K0173522 ( 0 ) DR 1 |  |  |    |                 |
| 光束   | 665.0 l m * 1.00    |  |  | 備考 | 非常点灯時の照度 (30分後) |
| 保守率  | 0.88                |  |  |    |                 |

非常灯配置表

|             |      |      |      |      |      |      |      |      |      |      |      |      |      |      |      |      |      |
|-------------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| 器具取付高さ (m)  |      | 2.1  | 2.2  | 2.3  | 2.4  | 2.5  | 2.6  | 2.7  | 2.8  | 2.9  | 3.0  | 3.1  | 3.2  | 3.3  | 3.4  | 3.5  | 3.6  |
| 単体配置        | A1   | 5.4  | 5.5  | 5.6  | 5.7  | 5.8  | 5.9  | 5.9  | 6.0  | 6.1  | 6.1  | 6.1  | 6.1  | 6.0  | 5.8  | 5.5  | 5.2  |
|             |      |      |      |      |      |      |      |      |      |      |      |      |      |      |      |      |      |
|             | B1   | 5.3  | 5.5  | 5.6  | 5.6  | 5.7  | 5.8  | 5.8  | 5.9  | 5.9  | 5.9  | 5.9  | 5.8  | 5.7  | 5.6  | 5.5  | 5.4  |
|             | B' 1 | 4.9  | 5.0  | 5.1  | 5.2  | 5.2  | 5.3  | 5.3  | 5.4  | 5.4  | 5.4  | 5.4  | 5.3  | 5.1  | 5.0  | 4.9  | 4.8  |
| 直線配置        | A2   | 12.5 | 12.8 | 13.1 | 13.4 | 13.7 | 14.0 | 14.3 | 14.5 | 14.8 | 15.0 | 15.2 | 15.4 | 15.6 | 15.9 | 16.0 | 16.2 |
|             | B2   | 11.7 | 12.0 | 12.4 | 12.7 | 13.0 | 13.3 | 13.6 | 13.9 | 14.1 | 14.4 | 14.6 | 14.8 | 15.0 | 15.2 | 15.3 | 15.4 |
| 四角配置        | A4   | 11.2 | 11.4 | 11.7 | 11.8 | 11.9 | 12.1 | 12.3 | 12.6 | 12.6 | 13.0 | 13.1 | 13.4 | 13.4 | 13.5 | 13.8 | 13.8 |
|             | B4   | 10.2 | 10.6 | 10.8 | 11.2 | 11.6 | 11.8 | 12.1 | 12.2 | 12.6 | 12.7 | 12.9 | 13.0 | 13.4 | 13.6 | 13.7 | 14.0 |
| 壁からの距離 (最大) | A0   | 3.7  | 3.7  | 3.8  | 3.7  | 3.7  | 3.7  | 3.7  | 3.7  | 3.7  | 3.8  | 3.7  | 3.8  | 3.6  | 3.5  | 3.5  | 3.3  |
|             | B0   | 2.7  | 2.8  | 2.9  | 3.1  | 3.3  | 3.3  | 3.4  | 3.4  | 3.5  | 3.5  | 3.5  | 3.5  | 3.6  | 3.7  | 3.8  | 3.8  |

|             |      |      |      |      |      |      |      |      |      |      |  |  |  |  |  |  |  |
|-------------|------|------|------|------|------|------|------|------|------|------|--|--|--|--|--|--|--|
| 器具取付高さ (m)  |      | 3.7  | 3.8  | 3.9  | 4.0  | 4.1  | 4.2  | 4.3  | 4.4  | 4.5  |  |  |  |  |  |  |  |
| 単体配置        | A1   | 5.0  | 4.8  | 4.6  | 4.4  | 4.3  | 4.2  | 4.0  | ---- | ---- |  |  |  |  |  |  |  |
|             |      |      |      |      |      |      |      |      |      |      |  |  |  |  |  |  |  |
|             | B1   | 5.3  | 5.2  | 5.1  | 5.1  | 5.0  | 4.9  | 4.8  | ---- | ---- |  |  |  |  |  |  |  |
|             | B' 1 | 4.7  | 4.6  | 4.5  | 4.4  | 4.3  | 4.2  | 4.1  | ---- | ---- |  |  |  |  |  |  |  |
| 直線配置        | A2   | 16.4 | 16.6 | 16.7 | 16.7 | 16.6 | 16.4 | 16.3 | 16.1 | 15.7 |  |  |  |  |  |  |  |
|             | B2   | 15.5 | 15.6 | 15.7 | 15.8 | 15.8 | 15.7 | 15.7 | 15.6 | 14.6 |  |  |  |  |  |  |  |
| 四角配置        | A4   | 14.2 | 14.2 | 14.5 | 14.6 | 14.8 | 15.0 | 15.2 | 15.4 | 15.5 |  |  |  |  |  |  |  |
|             | B4   | 14.0 | 14.3 | 14.4 | 14.5 | 14.7 | 14.8 | 14.8 | 14.9 | 14.6 |  |  |  |  |  |  |  |
| 壁からの距離 (最大) | A0   | 3.4  | 3.2  | 3.3  | 3.2  | 3.2  | 3.2  | 3.1  | 1.0  | 1.0  |  |  |  |  |  |  |  |
|             | B0   | 3.7  | 3.8  | 3.8  | 3.7  | 3.7  | 3.6  | 3.4  | 1.0  | 1.0  |  |  |  |  |  |  |  |

|             |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |
|-------------|--|--|--|--|--|--|--|--|--|--|--|--|--|--|--|--|--|
| 器具取付高さ (m)  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |
| 単体配置        |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |
|             |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |
|             |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |
|             |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |
| 直線配置        |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |
|             |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |
| 四角配置        |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |
|             |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |
| 壁からの距離 (最大) |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |
|             |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |  |