

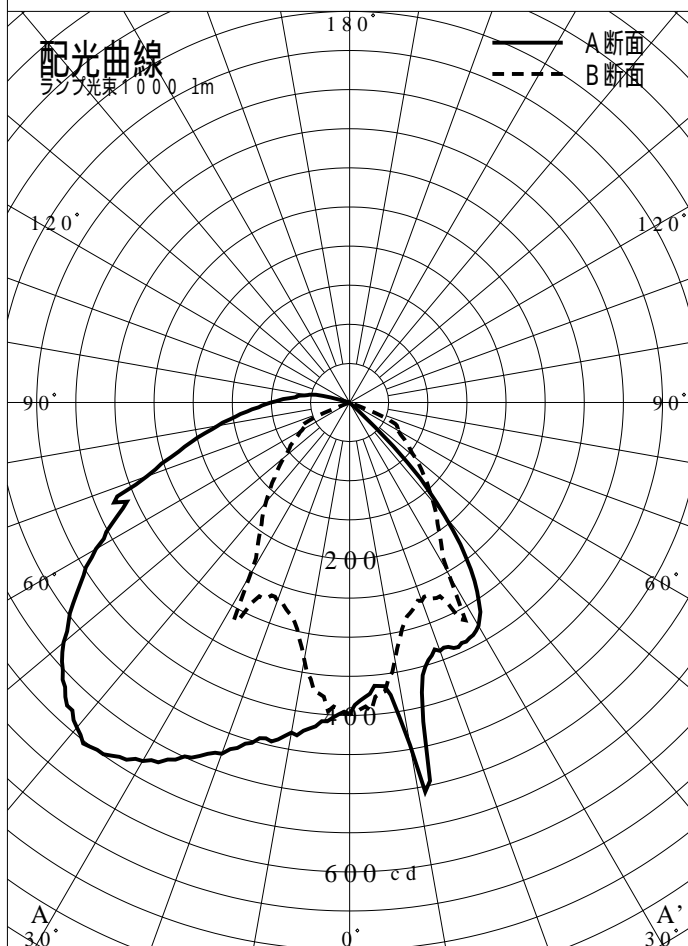


非常用照明器具特性

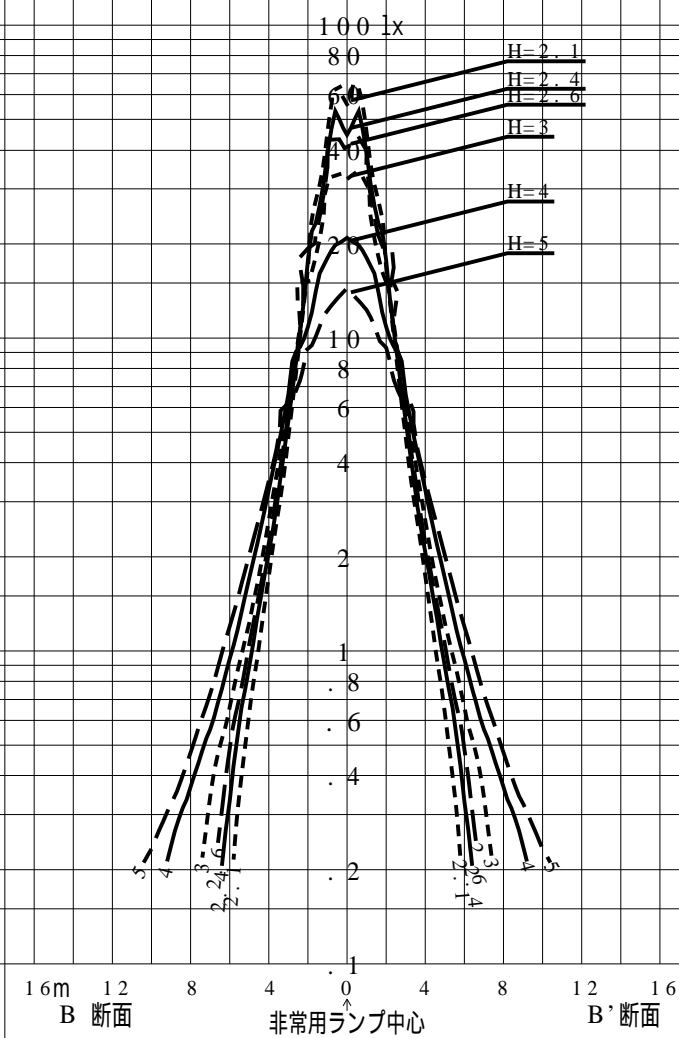

| | | | |
|-------------------------|-------------------------|-------|-------|
| 品番 | XLF436NTNJ (CEI LI NG) | | |
| 名称 | | | |
| 光源 | LED5000/98/480 | | |
| 管理番号 | K0151838(1)DR1 | | |
| 光束 | 960mm x 1.00 | | |
| 保守率 | 0.93 | | |
| 適用品番 | 設計照度Eを得るための読取照度 | | |
| | E=2.0 | E=1.0 | E=0.5 |
| XLF436NTNJ (CEI LI NG) | 2.2 | 1.1 | 0.6 |
| 備考 | 非常点灯時の照度 (60分後) | | |

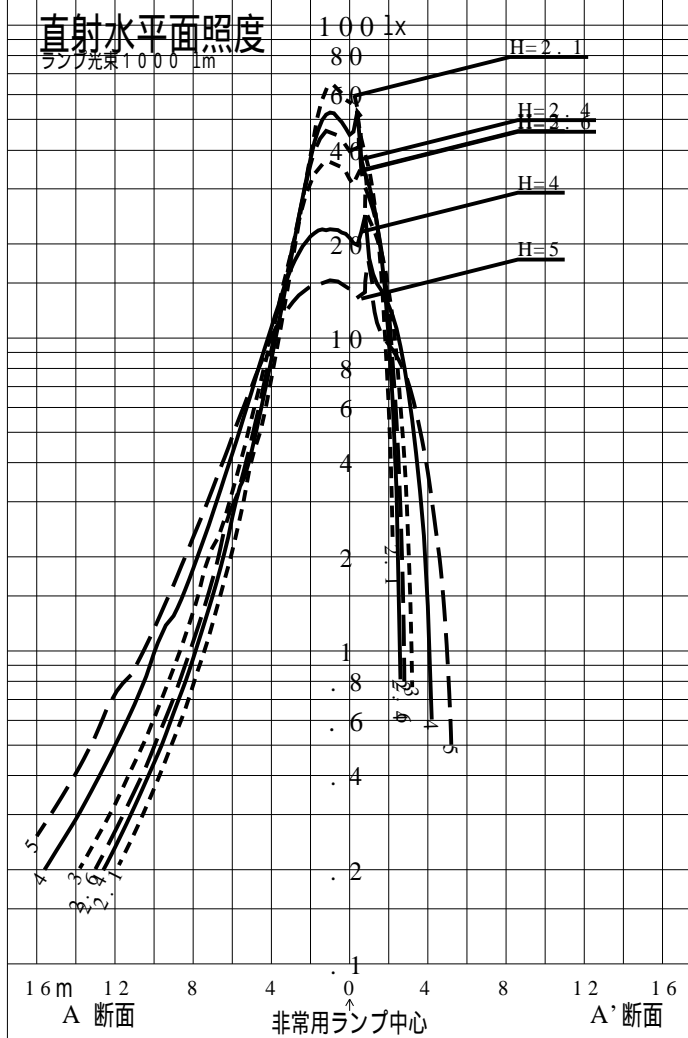

| | | | | | | |
|------|-------------------------|--|--|--|----|-----------------|
| 品番 | XLF436NTNJ (CEI LI NG) | | | | | |
| 名称 | | | | | | |
| 光源 | LED5000/98/480 | | | | | |
| 管理番号 | K0151838(15)DR 1 | | | | | |
| 光束 | 960.0 1m * 1.00 | | | | 備考 | 非常点灯時の照度 (60分後) |
| 保守率 | 0.93 | | | | | |

非常灯配置表

| | | | | | | | | | | | | | | | | | |
|-------------|-----|-----|-----|-----|-----|-----|-----|-----|-----|------|------|------|------|------|------|------|------|
| 器具取付高さ (m) | | 2.1 | 2.2 | 2.3 | 2.4 | 2.5 | 2.6 | 2.7 | 2.8 | 2.9 | 3.0 | 3.1 | 3.2 | 3.3 | 3.4 | 3.5 | 3.6 |
| 単体配置 | A1 | 5.9 | 6.0 | 6.2 | 6.3 | 6.4 | 6.5 | 6.7 | 6.8 | 6.9 | 6.9 | 6.9 | 6.9 | 7.0 | 7.1 | 7.2 | 7.2 |
| | A'1 | 2.2 | 2.3 | 2.4 | 2.5 | 2.6 | 2.7 | 2.7 | 2.8 | 2.9 | 3.0 | 3.1 | 3.2 | 3.3 | 3.3 | 3.4 | 3.5 |
| | B1 | 3.8 | 3.8 | 3.9 | 3.9 | 4.0 | 4.0 | 4.0 | 4.1 | 4.2 | 4.2 | 4.2 | 4.3 | 4.3 | 4.4 | 4.4 | 4.5 |
| 直線配置 | A2 | 8.2 | 8.5 | 8.7 | 9.0 | 9.2 | 9.4 | 9.7 | 9.9 | 10.1 | 10.1 | 10.5 | 10.5 | 10.7 | 10.9 | 11.1 | 11.2 |
| | B2 | 7.6 | 7.9 | 8.2 | 8.5 | 8.8 | 9.0 | 9.3 | 9.5 | 9.7 | 9.9 | 10.1 | 10.3 | 10.4 | 10.8 | 10.8 | 10.9 |
| 四角配置 | A4 | 7.4 | 7.4 | 7.8 | 7.7 | 7.9 | 7.9 | 8.4 | 8.5 | 8.7 | 8.8 | 8.9 | 9.2 | 9.2 | 9.4 | 9.6 | 9.7 |
| | B4 | 7.6 | 7.9 | 8.2 | 8.5 | 8.8 | 9.0 | 9.0 | 9.2 | 9.4 | 9.6 | 9.9 | 9.8 | 10.2 | 10.3 | 10.3 | 10.5 |
| 壁からの距離 (最大) | A0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.1 | 1.1 | 1.1 | 1.2 | 1.2 | 1.3 | 1.2 | 1.3 | 1.4 | 1.4 |
| | B0 | 2.5 | 2.8 | 2.7 | 2.9 | 2.9 | 3.2 | 3.1 | 3.1 | 3.2 | 3.3 | 3.4 | 3.3 | 3.6 | 3.5 | 3.5 | 3.6 |

| | | | | | | | | | | | | | | | | | |
|-------------|-----|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| 器具取付高さ (m) | | 3.7 | 3.8 | 3.9 | 4.0 | 4.1 | 4.2 | 4.3 | 4.4 | 4.5 | 5.0 | 5.5 | 6.0 | 6.5 | 7.0 | 7.5 | 8.0 |
| 単体配置 | A1 | 7.3 | 7.4 | 7.5 | 7.5 | 7.6 | 7.6 | 7.7 | 7.8 | 7.8 | 8.1 | 8.3 | 8.5 | 8.7 | 8.8 | 8.9 | 9.0 |
| | A'1 | 3.6 | 3.7 | 3.7 | 3.8 | 3.9 | 4.0 | 4.1 | 4.1 | 4.2 | 4.5 | 4.8 | 5.0 | 5.3 | 5.4 | 5.6 | 5.7 |
| | B1 | 4.5 | 4.5 | 4.6 | 4.6 | 4.6 | 4.6 | 4.7 | 4.7 | 4.7 | 4.8 | 4.9 | 5.0 | 5.0 | 5.0 | 5.0 | 5.1 |
| 直線配置 | A2 | 11.4 | 11.6 | 11.8 | 12.0 | 12.1 | 12.3 | 12.5 | 12.7 | 12.8 | 13.7 | 14.4 | 15.1 | 15.8 | 16.4 | 17.0 | 17.6 |
| | B2 | 11.1 | 11.2 | 11.3 | 11.4 | 11.5 | 11.6 | 11.7 | 11.8 | 11.9 | 12.3 | 12.5 | 13.0 | 13.1 | 13.3 | 13.4 | 13.5 |
| 四角配置 | A4 | 9.9 | 10.2 | 10.2 | 10.6 | 10.6 | 11.0 | 11.2 | 11.2 | 11.4 | 12.3 | 13.0 | 14.0 | 14.5 | 14.8 | 15.5 | 16.0 |
| | B4 | 10.6 | 10.6 | 10.8 | 10.7 | 11.0 | 10.9 | 11.0 | 11.2 | 11.3 | 11.7 | 12.2 | 12.2 | 12.7 | 13.2 | 13.4 | 13.5 |
| 壁からの距離 (最大) | A0 | 1.4 | 1.6 | 1.5 | 1.8 | 1.6 | 1.8 | 1.8 | 1.8 | 1.8 | 2.0 | 2.1 | 2.4 | 2.2 | 1.2 | 1.0 | 1.1 |
| | B0 | 3.5 | 3.6 | 3.6 | 3.5 | 3.7 | 3.5 | 3.6 | 3.6 | 3.6 | 3.6 | 3.7 | 3.3 | 3.6 | 3.7 | 3.5 | 3.5 |

| | | | | | | | | | | | | | | | | | |
|-------------|-----|------|------|------|------|------|------|------|------|------|------|--|--|--|--|--|--|
| 器具取付高さ (m) | | 8.5 | 9.0 | 9.5 | 10.0 | 10.5 | 11.0 | 11.5 | 12.0 | 12.5 | 13.0 | | | | | | |
| 単体配置 | A1 | 9.0 | 9.0 | 8.9 | 8.8 | 8.7 | 8.5 | 8.1 | 7.6 | 6.8 | ---- | | | | | | |
| | A'1 | 5.7 | 5.7 | 5.6 | 5.5 | 5.1 | 4.4 | 3.7 | 3.3 | 3.2 | ---- | | | | | | |
| | B1 | 5.2 | 4.7 | 4.6 | 3.8 | 3.2 | 2.8 | 2.4 | 2.0 | 1.6 | ---- | | | | | | |
| 直線配置 | A2 | 18.1 | 18.6 | 19.0 | 19.3 | 19.6 | 19.8 | 19.9 | 20.1 | 20.0 | 13.6 | | | | | | |
| | B2 | 13.6 | 13.6 | 13.6 | 13.5 | 13.3 | 13.2 | 13.0 | 12.9 | 12.7 | 12.0 | | | | | | |
| 四角配置 | A4 | 16.6 | 17.2 | 18.0 | 18.4 | 19.2 | 19.5 | 19.9 | 20.1 | 20.0 | 13.6 | | | | | | |
| | B4 | 13.6 | 13.6 | 13.6 | 13.5 | 13.3 | 13.2 | 13.0 | 12.9 | 12.6 | 12.0 | | | | | | |
| 壁からの距離 (最大) | A0 | 1.1 | 1.2 | 1.1 | 1.1 | 1.0 | 1.1 | 1.0 | 1.0 | 1.1 | 1.0 | | | | | | |
| | B0 | 3.3 | 3.0 | 2.5 | 2.4 | 1.8 | 1.7 | 1.0 | 1.2 | 1.3 | 1.0 | | | | | | |

階段配置表

| | | | | | | | | | | | | |
|------------|-------|----|-----|-----|-----|-----|-----|-----|------|------|------|------|
| 器具取付高さ (m) | | | 1.0 | 1.5 | 2.0 | 2.5 | 3.0 | 4.0 | 5.0 | 6.0 | 7.0 | 8.0 |
| Y=1.0 (m) | 2.0Lx | X+ | 4.1 | 4.9 | 5.6 | 6.2 | 6.7 | 7.4 | 8.0 | 8.4 | 8.7 | 8.8 |
| | | X- | 1.1 | 1.5 | 2.0 | 2.5 | 2.9 | 3.7 | 4.3 | 4.8 | 5.2 | 5.4 |
| | 1.0Lx | X+ | 5.1 | 6.1 | 6.9 | 7.6 | 8.3 | 9.5 | 10.1 | 10.8 | 11.3 | 11.8 |
| Y=1.5 (m) | 2.0Lx | X+ | 3.9 | 4.7 | 5.4 | 6.1 | 6.6 | 7.3 | 7.9 | 8.3 | 8.6 | 8.7 |
| | | X- | 1.0 | 1.5 | 1.9 | 2.4 | 2.8 | 3.5 | 4.2 | 4.6 | 4.9 | 5.1 |
| | 1.0Lx | X+ | 4.9 | 5.9 | 6.8 | 7.5 | 8.2 | 9.4 | 10.0 | 10.7 | 11.3 | 11.7 |
| Y=2.0 (m) | 2.0Lx | X+ | 3.6 | 4.5 | 5.2 | 5.9 | 6.4 | 7.1 | 7.7 | 8.1 | 8.4 | 8.5 |
| | | X- | 0.7 | 1.3 | 1.8 | 2.2 | 2.7 | 3.3 | 3.9 | 4.4 | 4.6 | 4.7 |
| | 1.0Lx | X+ | 4.7 | 5.7 | 6.6 | 7.3 | 8.0 | 9.3 | 9.9 | 10.6 | 11.2 | 11.6 |